## **DATASHEET - NZMC1-A160**



Circuit-breaker, 3p, 160A

Part no. NZMC1-A160 Catalog No. 283296




Similar to illustration

Product range Product range Protective function Standard/Approval Installation type Release system Construction size Number of poles Switching capacity 400/15 V5 0Hz Rated current = rated uninterrupted current Rated current = rated uninterrupted current Rough Current = rated uninterrupted current  Rough C	Delivery program			
Protective function Standard/Approval Installation type Release system Construction size Number of poles Standard equipment Switching capacity 400/415 V 50 Hz Rated current = rated uninterrupted current Rated current = rated uninterrupted current Rated current = rated uninterrupted current  Southing canage  Overload trip  Ir A D 160  Short-circuit releases  Non-delayed I, = I <sub>n</sub> x  Short-circuit releases  Short-circuit releases				Circuit-broaker
Standard/Approval Installation type Release system Construction size Number of poles Standard equipment Switching capacity 400/415 V 50 Hz Rated current = rated uninterrupted current Rated current = rated uninterrupted current Rowerload trip  Ir  Ir  Ir  A  125 - 160  Short-circuit releases  Short-circuit releases  Short-circuit releases  Short-circuit releases				
Installation type Release system Construction size Number of poles Standard equipment Switching capacity 400/415 V 50 Hz Rated current = rated uninterrupted current Rated current = rated uninterrupted current Rough Installation type  Ir  Short-circuit releases Short-circuit releases Short-circuit releases  Non-delayed Short-circuit releases				
Release system  Construction size  Number of poles  Standard equipment  Switching capacity  400/415 V 50 Hz  Rated current = rated uninterrupted current  Rated current = rated uninterrupted current  Rough current = rated uninterrupted current  In = Iu A 160  Setting range  Overload trip  Ir A 125 - 160  Short-circuit releases  Non-delayed  Non-delayed  Short-circuit releases  Short-circuit releases				
Construction size  Number of poles  Standard equipment  Switching capacity  400/415 V 50 Hz  Rated current = rated uninterrupted current  Rated current = rated uninterrupted current  In = Iu A 160  Setting range  Overload trip  Ir A 125 - 160  Short-circuit releases  Non-delayed  Short-circuit releases  Short-circuit releases				
Number of poles  Standard equipment  Switching capacity  400/415 V 50 Hz  Rated current = rated uninterrupted current  Rated current = rated uninterrupted current  In = Iu  Overload trip  Ir  Non-delayed  Non-delayed  Short-circuit releases  Short-circuit releases  Short-circuit releases				
Standard equipment  Switching capacity  400/415 V 50 Hz  Rated current = rated uninterrupted current  Rated current = rated uninterrupted current  Part of current = rated uninterrupted current  In = Iu A 160  Setting range  Overload trip  Ir A 125 - 160  Short-circuit releases  Non-delayed  Short-circuit releases  Short-circuit releases				
Switching capacity  400/415 V 50 Hz  Rated current = rated uninterrupted current  Rated current = rated uninterrupted current  In = Iu A 160  Setting range  Overload trip  Ir A 125 - 160  Short-circuit releases  Non-delayed  Short-circuit releases  Short-circuit releases				
400/415 V 50 Hz  Rated current = rated uninterrupted current  Rated current = rated uninterrupted current  In = Iu A 160  Setting range  Overload trip  Ir A 125 - 160  Short-circuit releases  In = In x I 1280 A fixed				
Rated current = rated uninterrupted current  Rated current = rated uninterrupted current  In = Iu A 160  Setting range  Overload trip  Ir A 125 - 160  Short-circuit releases  Non-delayed  Ij = In x 1290 A fixed		1	kΔ	36
Rated current = rated uninterrupted current  Setting range  Overload trip  Ir  A  125 - 160  Short-circuit releases  Non-delayed  Short-circuit releases  Short-circuit releases	·	·cu	IO C	
Overload trip  Ir A 125 - 160  Short-circuit releases  Ii = In x 1280 A fixed				
Overload trip  Ir A 125 - 160  Short-circuit releases  Non-delayed  Ii = In x  Short-circuit releases		$I_n = I_u$	А	160
Short-circuit releases  Non-delayed  I <sub>i</sub> = I <sub>n</sub> x  Short-circuit releases  I <sub>i</sub> = I <sub>n</sub> x				
Short-circuit releases  Non-delayed  I <sub>i</sub> = I <sub>n</sub> x  1280 A fixed  Short-circuit releases	Overload trip			
Non-delayed $I_i = I_n \times \dots$ 1280 A fixed Short-circuit releases	4	l <sub>r</sub>	A	125 - 160
Short-circuit releases	1			
	Non-delayed	$I_i = I_n x \dots$		1280 A fixed
	1			
max. A 1280	max.		Α	1280

### Technical data General

Conorai			
Standards			IEC/EN 60947
Protection against direct contact			Finger and back of hand proof to VDE 0106 Part 100
Climatic proofing			Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature			
Ambient temperature, storage	o	°C	- 40 - + 70
Operation	o	°C	-25 - +70
Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27	ç	9	20 (half-sinusoidal shock 20 ms)
Safe isolation to EN 61140			
Between auxiliary contacts and main contacts	١	V AC	500
between the auxiliary contacts	١	V AC	300
Mounting position			Vertical and 90° in all directions



With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions

90° in all directions
with plug-in unit
- NZM1, N1, NZM2, N2: vertical, 90°
right/left
with withdrawable unit:
- NZM3, N3: vertical, 90° right/left
- NZM4, N4: vertical

with remote operator:
- NZM2, N(S)2, NZM3, N(S)3,
NZM4, N(S)4: vertical and 90° in all directions

Direction of incoming supply	as required
Degree of protection	
Device	In the operating controls area: IP20 (basic degree of protection)
Enclosures	With insulating surround: IP40 With door coupling rotary handle: IP66
Terminations	Tunnel terminal: IP10 Phase isolator and strip terminal: IP00
Other technical data (sheet catalogue)	Temperature dependency, Derating

#### **Circuit-breakers**

Rated current = rated uninterrupted current	$I_n = I_u$	Α	160
Rated surge voltage invariability	$U_{imp}$		
Main contacts		V	6000
Auxiliary contacts		V	6000
Rated operational voltage	U <sub>e</sub>	V AC	690
Overvoltage category/pollution degree			III/3
Rated insulation voltage	Ui	V	690
Use in unearthed supply systems		V	≦ 690

#### Switching capacity

Max. operating frequency

Switching capacity			
Rated short-circuit making capacity	I <sub>cm</sub>		
240 V	I <sub>cm</sub>	kA	121
400/415 V	I <sub>cm</sub>	kA	76
440 V 50/60 Hz	I <sub>cm</sub>	kA	63
525 V 50/60 Hz	I <sub>cm</sub>	kA	24
690 V 50/60 H	Ic	kA	14
Rated short-circuit breaking capacity $I_{\rm cn}$	I <sub>cn</sub>		
Icu to IEC/EN 60947 test cycle 0-t-C0	lcu	kA	
240 V 50/60 Hz	Icu	kA	55
400/415 V 50/60 Hz	I <sub>cu</sub>	kA	36
440 V 50/60 Hz	I <sub>cu</sub>	kA	30
525 V 50/60 Hz	I <sub>cu</sub>	kA	12
690 V 50/60 Hz	I <sub>cu</sub>	kA	8
lcs to IEC/EN 60947 test cycle 0-t-C0-t-C0	Ics	kA	
240 V 50/60 Hz	I <sub>cs</sub>	kA	55
400/415 V 50/60 Hz	I <sub>cs</sub>	kA	36
440 V 50/60 Hz	I <sub>cs</sub>	kA	22.5
525 V 50/60 Hz	I <sub>cs</sub>	kA	6
690 V 50/60 Hz	I <sub>cs</sub>	kA	4
			Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker.
Utilization category to IEC/EN 60947-2			A
Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release)	Operations		20000
Lifespan, electrical			
AC-1			
400 V 50/60 Hz	Operations		7500
415 V 50/60 Hz	Operations		7500
690 V 50/60 Hz	Operations		5000

Ops/h 120

Total break time at short-circuit		ms	<10
Terminal capacity			
Standard equipment			Box terminal
Optional accessories			Screw connection Tunnel terminal connection on rear
Round copper conductor			
Box terminal			
Solid		mm <sup>2</sup>	1 x (10 - 16) 2 x (6 - 16)
Stranded		mm <sup>2</sup>	1 x (10 - 70) <sup>3)</sup> 2 x (6-25)
			$^{3)}\mathrm{Up}$ to 95 $\mathrm{mm^2}\mathrm{can}$ be connected depending on the cable manufacturer.
Tunnel terminal			
Solid		mm <sup>2</sup>	1 x 16
Stranded			
1-hole		$\text{mm}^2$	1 x (25 - 95)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm <sup>2</sup>	1 x (10 - 16) 2 x (6 - 16)
Stranded		mm <sup>2</sup>	1 x (10 - 70) <sup>3)</sup> 2 x 25
			<sup>3)</sup> Up to 95 mm <sup>2</sup> can be connected depending on the cable manufacturer.
Al circular conductor			
Tunnel terminal			
Solid		mm <sup>2</sup>	1 x 16
Stranded			
Stranded		mm <sup>2</sup>	1 x (25 - 95)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm <sup>2</sup>	1 x (10 - 16)
			2 x (10 - 16)
Stranded		mm <sup>2</sup>	1 x (25 - 35) 2 x (25 - 35)
Cu strip (number of segments x width x segment thickness)			
Box terminal			
	min.	mm	2 x 9 x 0.8
	max.	mm	9 x 9 x 0.8
Copper busbar (width x thickness)	mm		
Bolt terminal and rear-side connection			
Screw connection			M6
Direct on the switch			
	min.	mm	12 x 5
	max.	mm	16 x 5
Control cables			
		mm <sup>2</sup>	1 x (0.75 - 2.5) 2 x (0.75 - 1.5)

# Design verification as per IEC/EN 61439

Technical data for design verification			
Rated operational current for specified heat dissipation	In	Α	160
Equipment heat dissipation, current-dependent	P <sub>vid</sub>	W	36.1
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.

10.2.3.1 Verification of thermal stability of enclosures	Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat	Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects	Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation	Meets the product standard's requirements.
10.2.5 Lifting	Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact	Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions	Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES	Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances	Meets the product standard's requirements.
10.5 Protection against electric shock	Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components	Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections	Is the panel builder's responsibility.
10.8 Connections for external conductors	Is the panel builder's responsibility.
10.9 Insulation properties	
10.9.2 Power-frequency electric strength	Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage	Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material	Is the panel builder's responsibility.
10.10 Temperature rise	The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function	The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.


### **Technical data ETIM 7.0**


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])

Rated permanent current lu	Α	160
Rated voltage	V	690 - 690
Rated short-circuit breaking capacity Icu at 400 V, 50 Hz	kA	36
Overload release current setting	Α	125 - 160
Adjustment range short-term delayed short-circuit release	Α	0 - 0
Adjustment range undelayed short-circuit release	Α	960 - 1600
Integrated earth fault protection		No
Type of electrical connection of main circuit		Frame clamp
Device construction		Built-in device fixed built-in technique
Suitable for DIN rail (top hat rail) mounting		No
DIN rail (top hat rail) mounting optional		Yes
Number of auxiliary contacts as normally closed contact		0
Number of auxiliary contacts as normally open contact		0
Number of auxiliary contacts as change-over contact		0
With switched-off indicator		No
With under voltage release		No
Number of poles		3
Position of connection for main current circuit		Front side
Type of control element		Rocker lever
Complete device with protection unit		Yes
Motor drive integrated		No
Motor drive optional		No
Degree of protection (IP)		IP20


### **Characteristics**

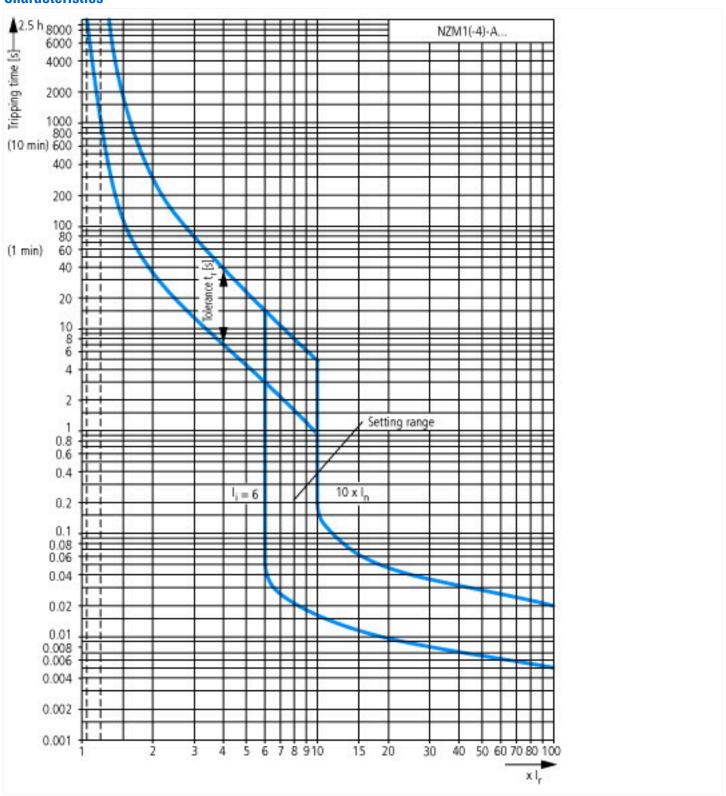


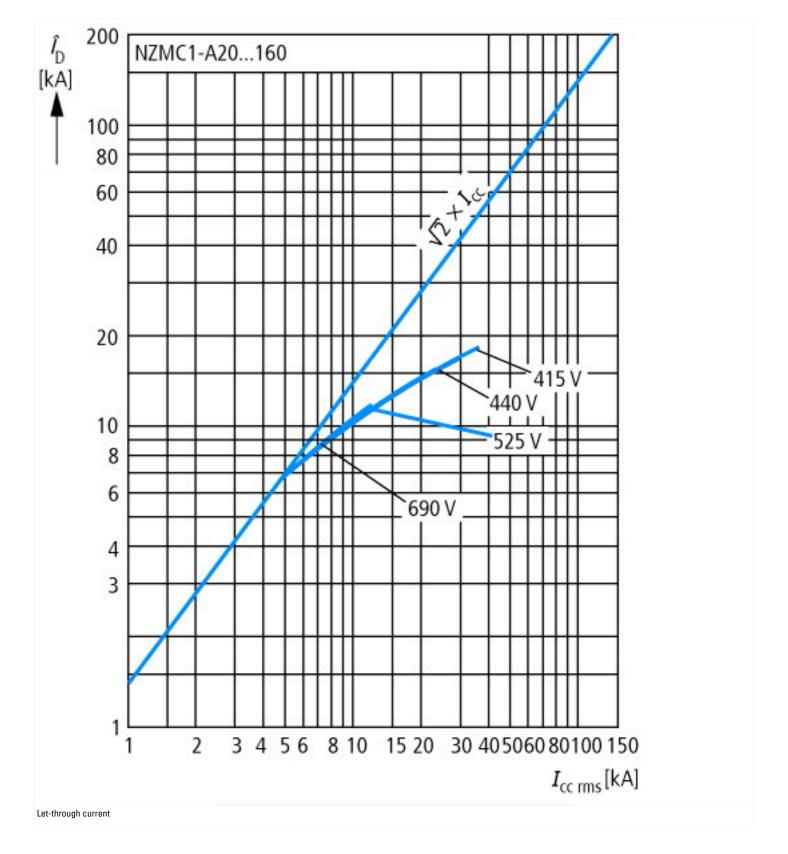

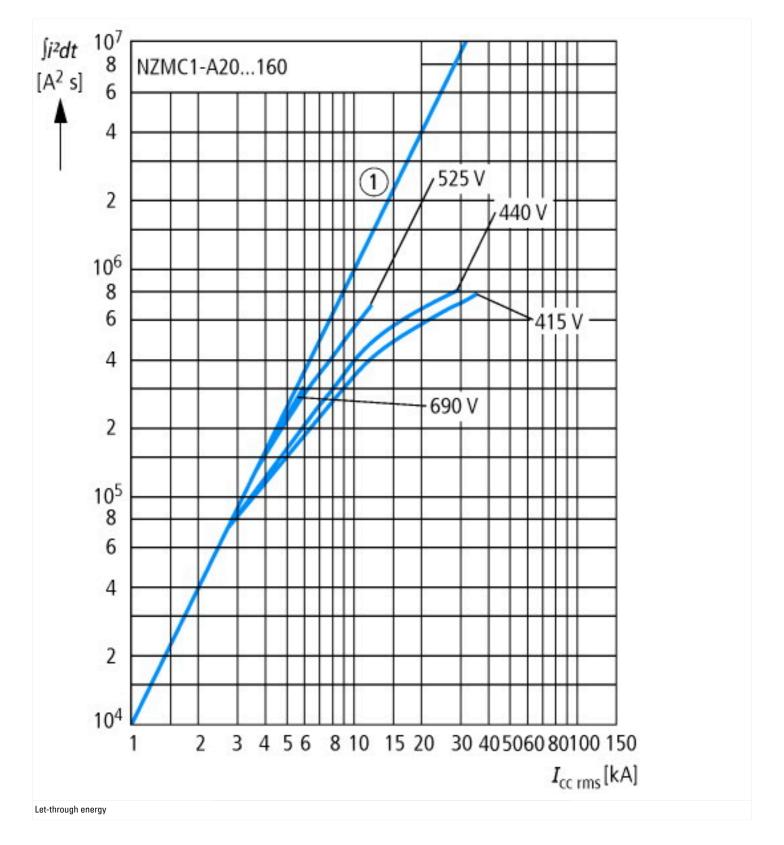

## **Dimensions**

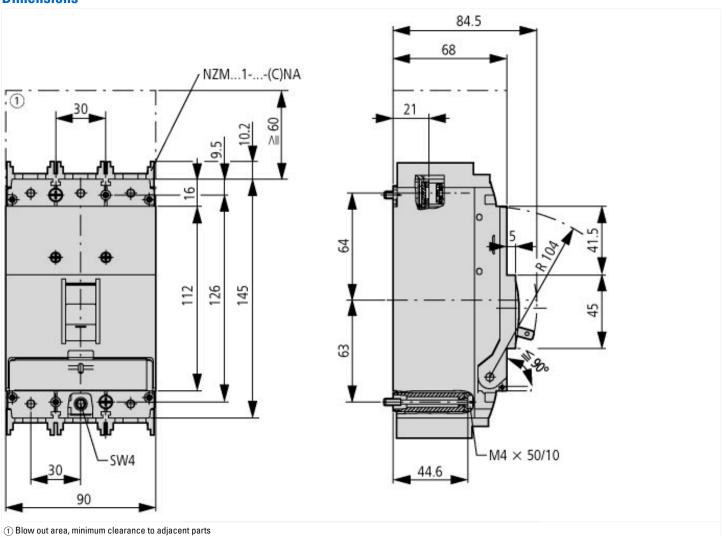

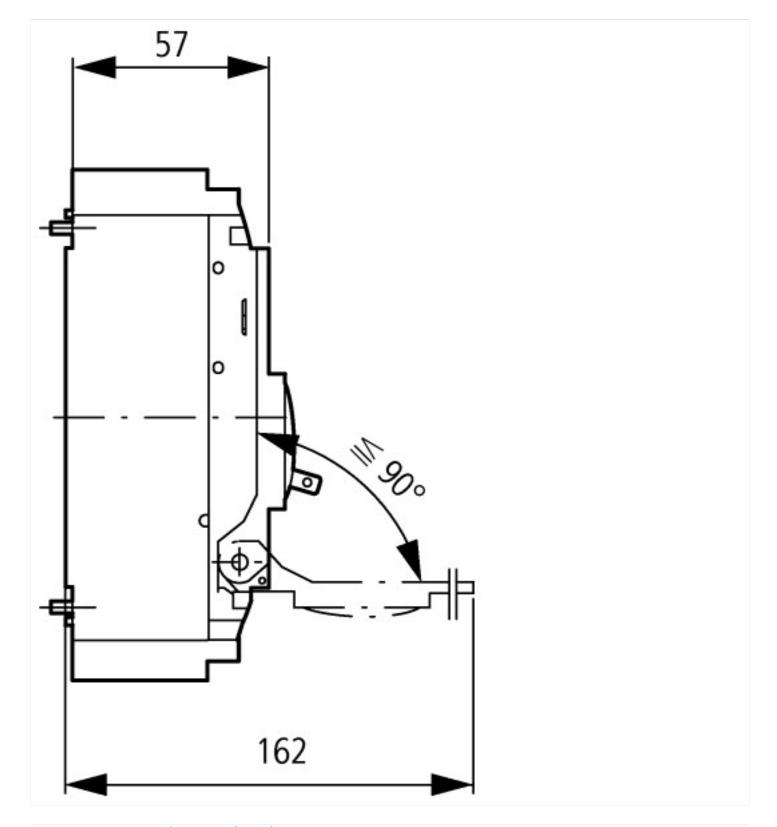

# Additional product information (links)

IL01203004Z (AWA1230-1913) Circuit-breaker, Switch-Disconnector	
IL01203004Z (AWA1230-1913) Circuit-breaker, Switch-Disconnector	ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL01203004Z2015_11.pdf
Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172
CurveSelect characteristics program	http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/index.htm
additional technical information for NZM power switch	ftp://ftp.moeller.net/DOCUMENTATION/PDF/nzm_technic_de_en.pdf